


SEGMENT B-C, E-F



NOT TO SCALE

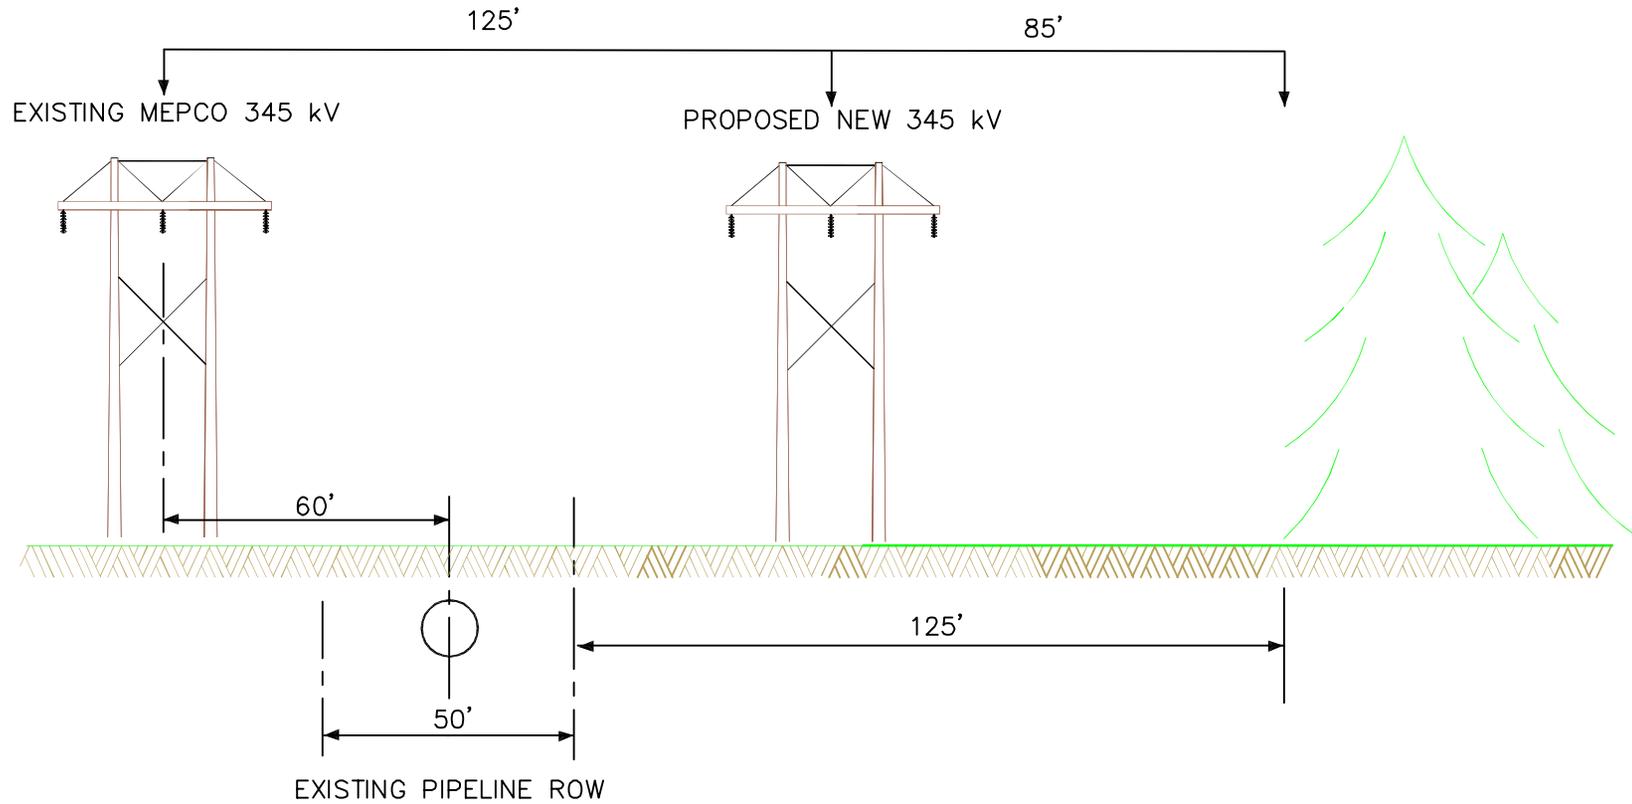

APPENDIX 1-3
TYPICAL ROW CONFIGURATION
ALONG EXISTING MEPCO AND EXISTING PIPELINE ROW
BANGOR HYDRO-ELECTRIC COMPANY
NORTHEAST RELIABILITY INTERCONNECT