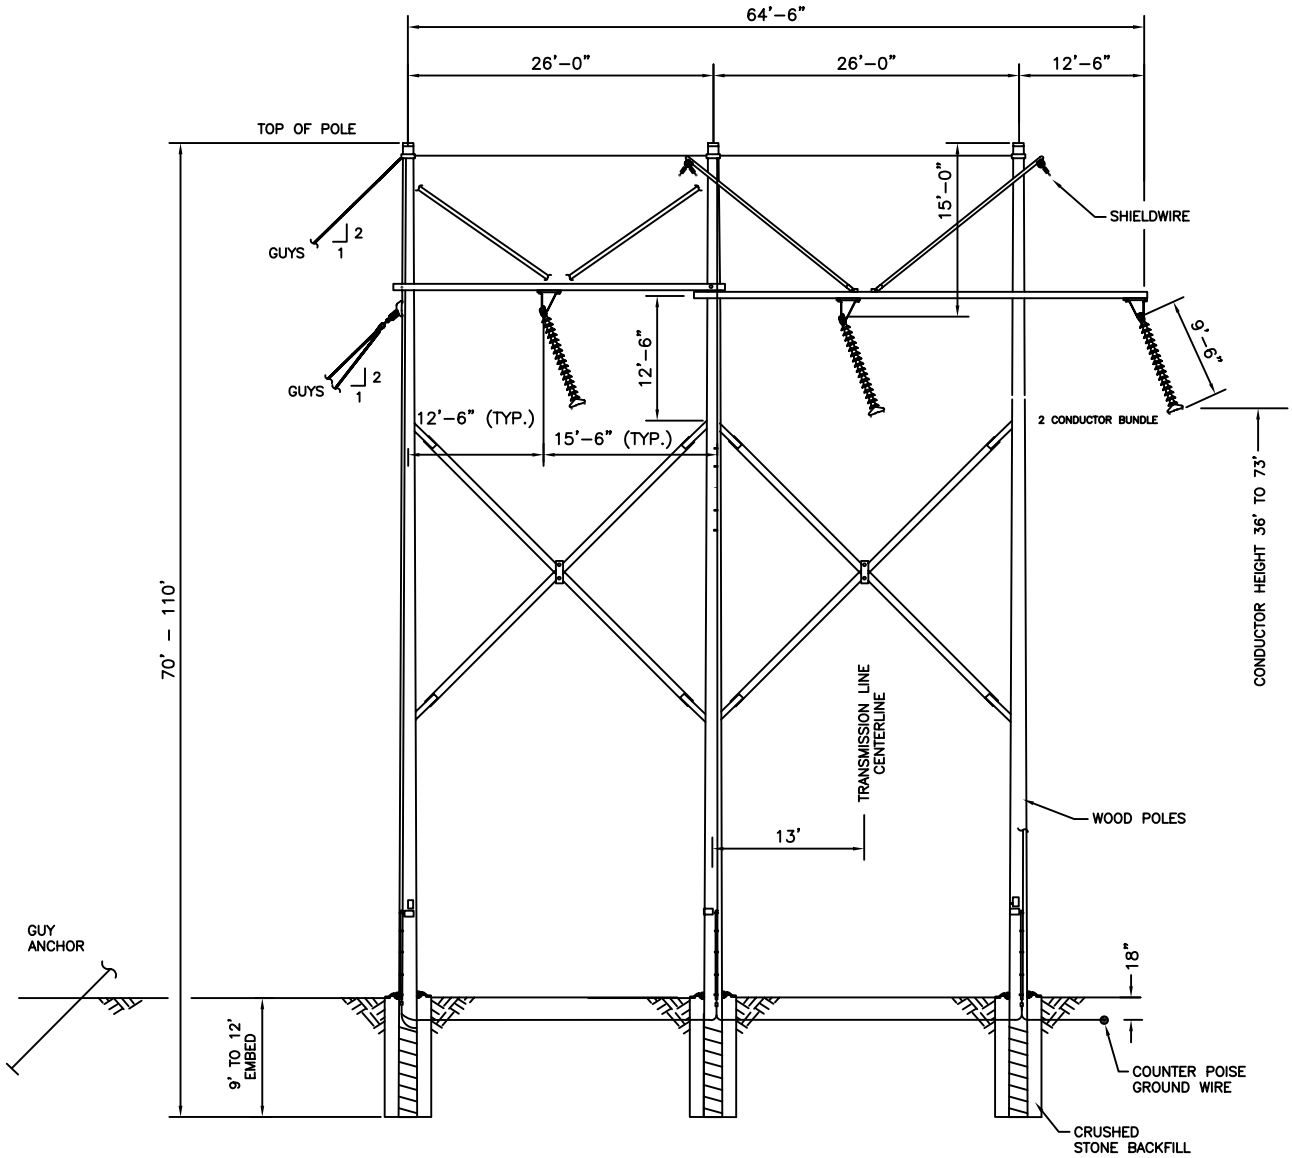

FIGURE 1-3
TYPICAL 345 kV OVERHEAD
W-LA WOOD LIGHT ANGLE STRUCTURE 1° - 5°
BANGOR HYDRO-ELECTRIC COMPANY
NORTHEAST RELIABILITY INTERCONNECT