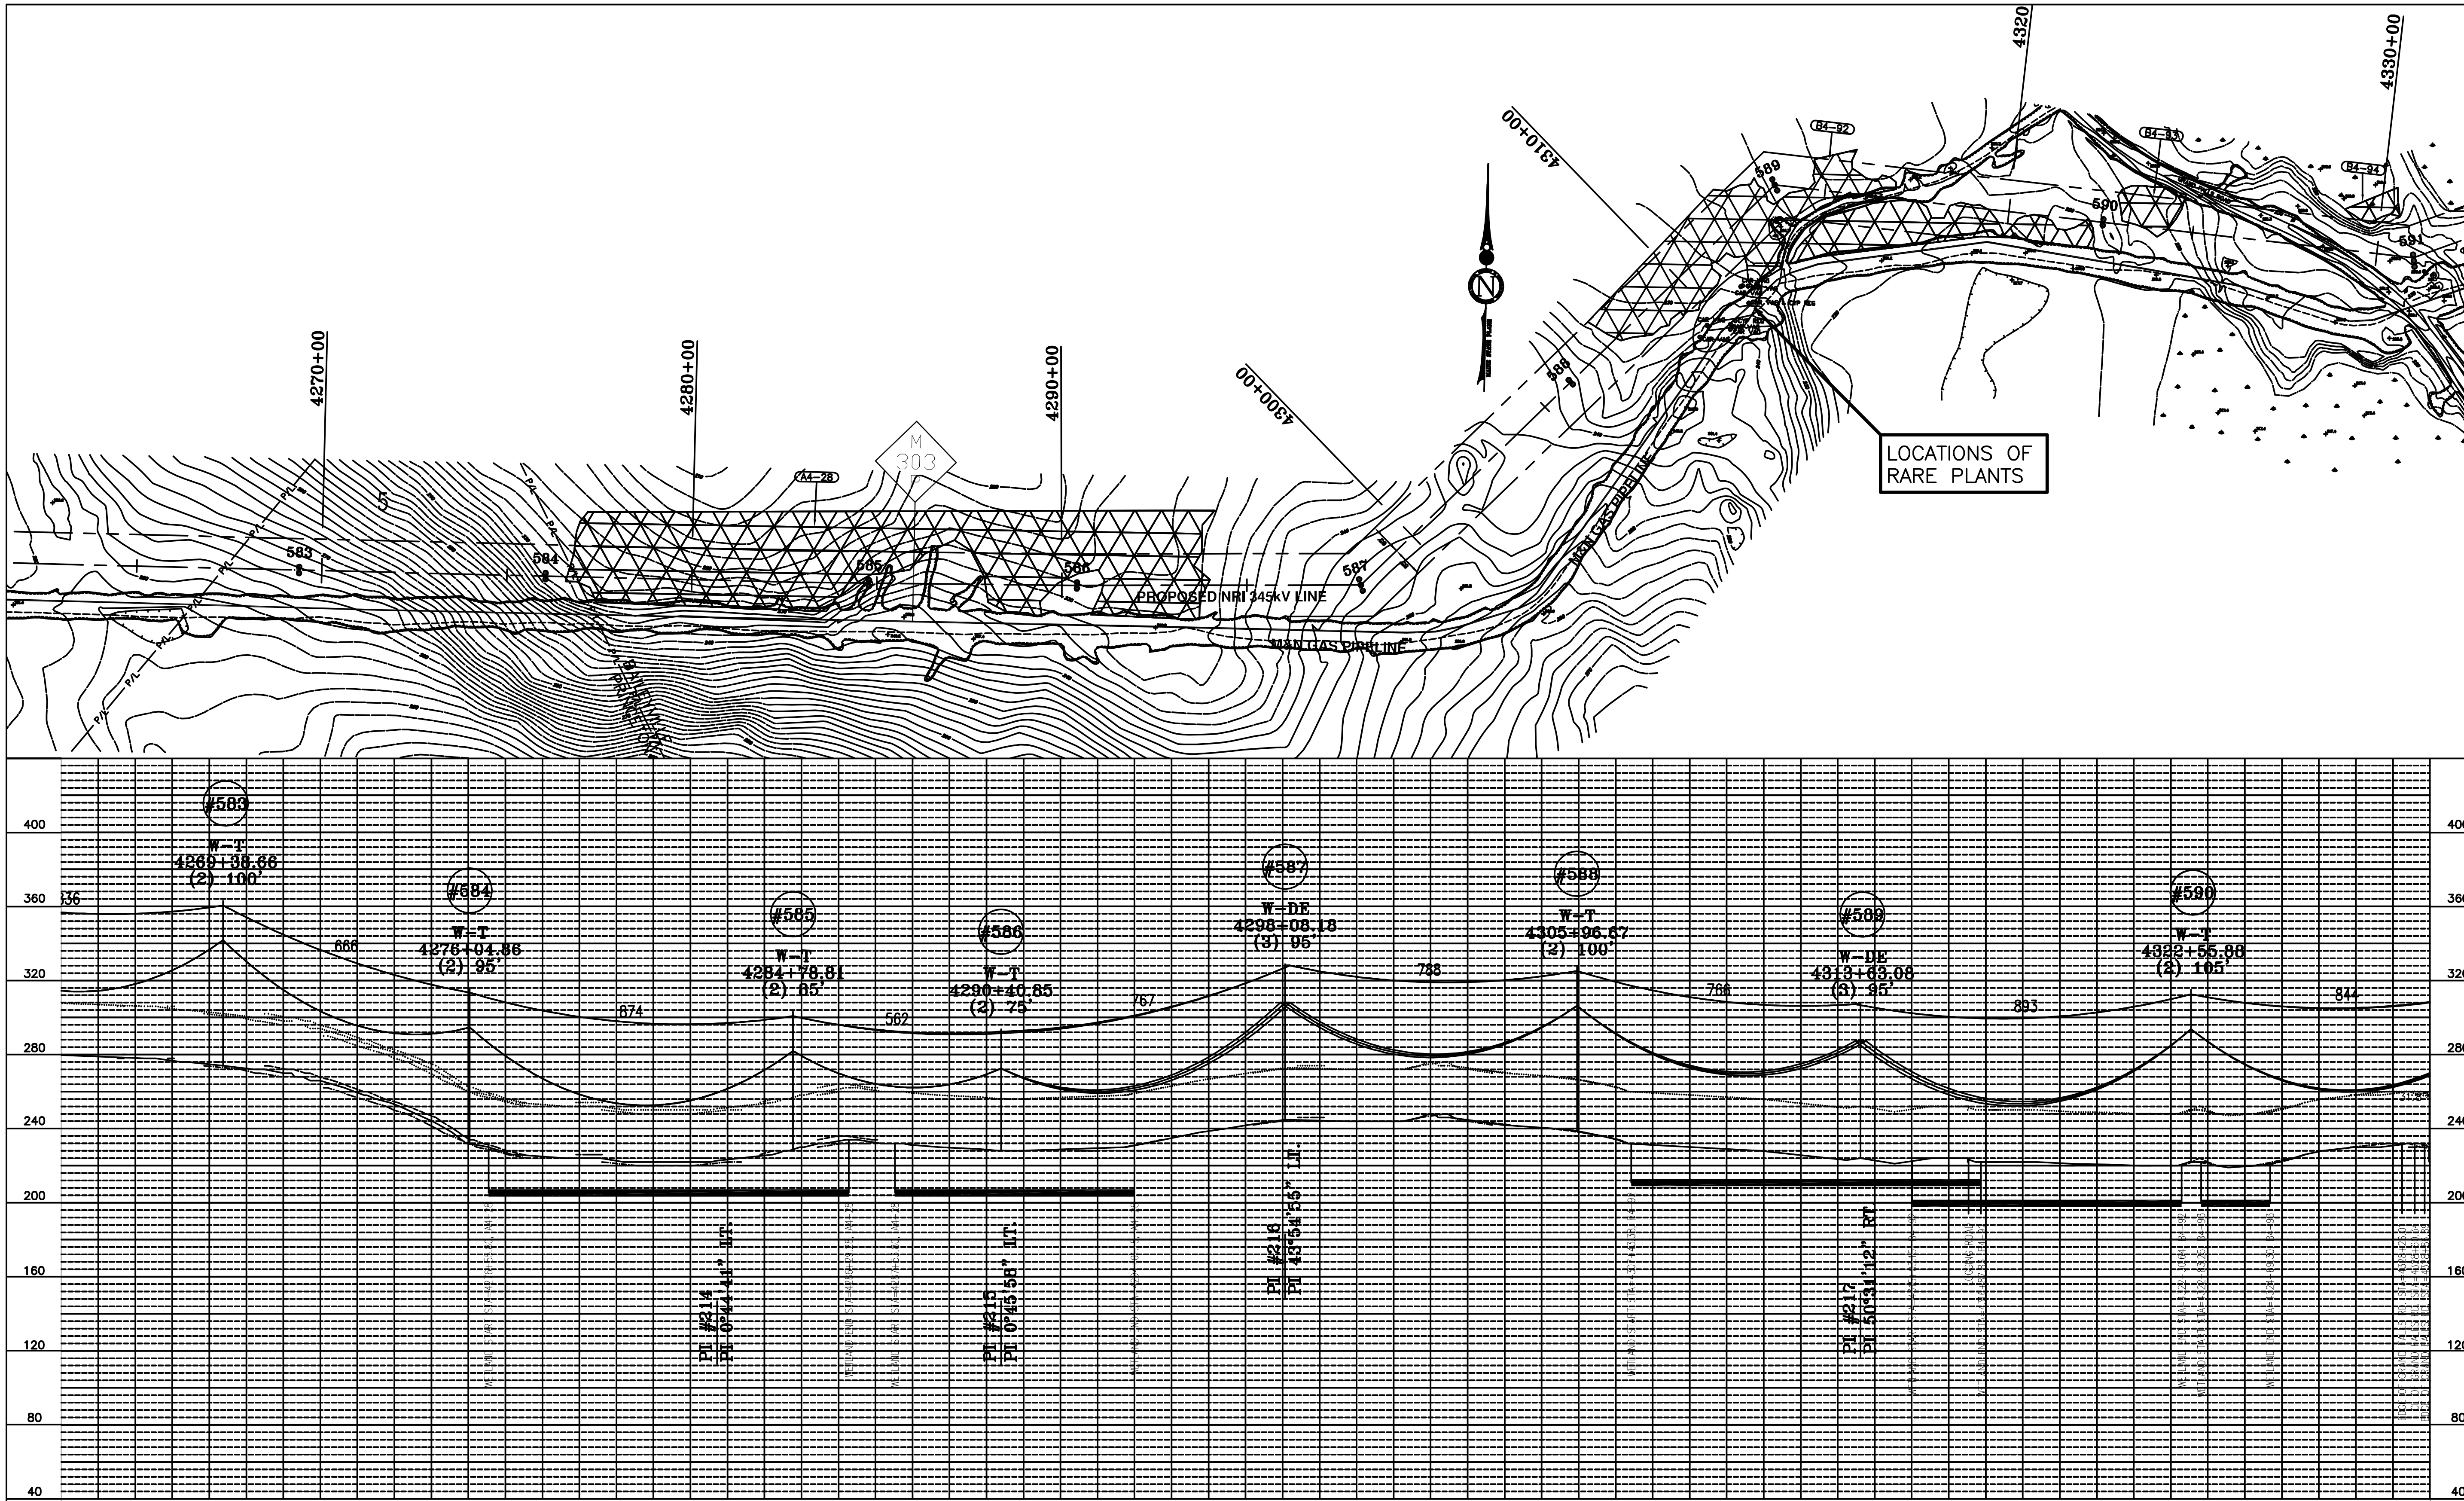

PLAN		BY	DATE
	SURVEYED		
NOTEBOOK NO.	REVIEWED		
	NOTES REDUCED		

PROFILE		BY	DATE
	SURVEYED		
NOTEBOOK NO.	REVIEWED		
	NOTES REDUCED		

THIS DRAWING SHALL BE REVISED ON THE CADD SYSTEM ONLY

CAI Commonwealth Associates Inc.
Jackson, Michigan
engineers consultants construction management

SCALE
HORIZONTAL SCALE 1" = 200'
200 100 0 200 400 600 800
(VERTICAL SCALE: 1" = 40')

NOTES

PRELIMINARY
NOT FOR CONSTRUCTION

FEBRUARY 25, 2005

NO.	REVISION	DATE	BY	CK	P.E. STAMPED BY	P.E. No.
A	ISSUED FOR CLIENT REVIEW	10/22/04	BMK	RAO	RNC	
B	ISSUED FOR CLIENT REVIEW	12/22/04	BMK	RAO	RNC	
C	ISSUED FOR CLIENT REVIEW	01/29/05	BMK	RAO	RNC	
D	ISSUED FOR CLIENT REVIEW	02/25/05	KSC	RAO	RNC	
		/ /				
		/ /				
		/ /				

CLIENT APPROVAL
APPROVED BY
COMPANY
DATE

RAO DESIGNED
BMK DRAWN
RNC CHECKED
APPROVED
REVIEWED

BANGOR HYDRO-ELECTRIC COMPANY
NORTHEAST RELIABILITY INTERCONNECT
345 kV LINE
ORRINGTON TO ST. CROIX RIVER

FIGURE 1

REV. A

DRAWING DATE 10/22/04

SHEET 74 OF 77

Bangor Hydro ELECTRIC COMPANY

FILENAME: SHEET_71-77.DWG